


**BLOW-OFF
SIZES REQUIRED
(ASSUMES 40 PSI RESIDUAL PRESS.)**

MAIN SIZE	BLOW-OFF SIZE
6" - 8"	2"
10" - 12"	4"
>12"	BY ENGR.

NOTES:

1. BACKFILL WITH GRANULAR BACKFILL.
2. REQUIRED ON ALL LINES WHICH MAY BE EXTENDED IN FUTURE OR AS DIRECTED BY CITY ENGINEER.
3. ALL CONCRETE TO BE 3300 PSI @ 28 DAYS.
4. FLANGED DUCTILE IRON PIPE AND FITTINGS MAY BE REQUIRED FOR 4" & LARGER BLOWOFFS.

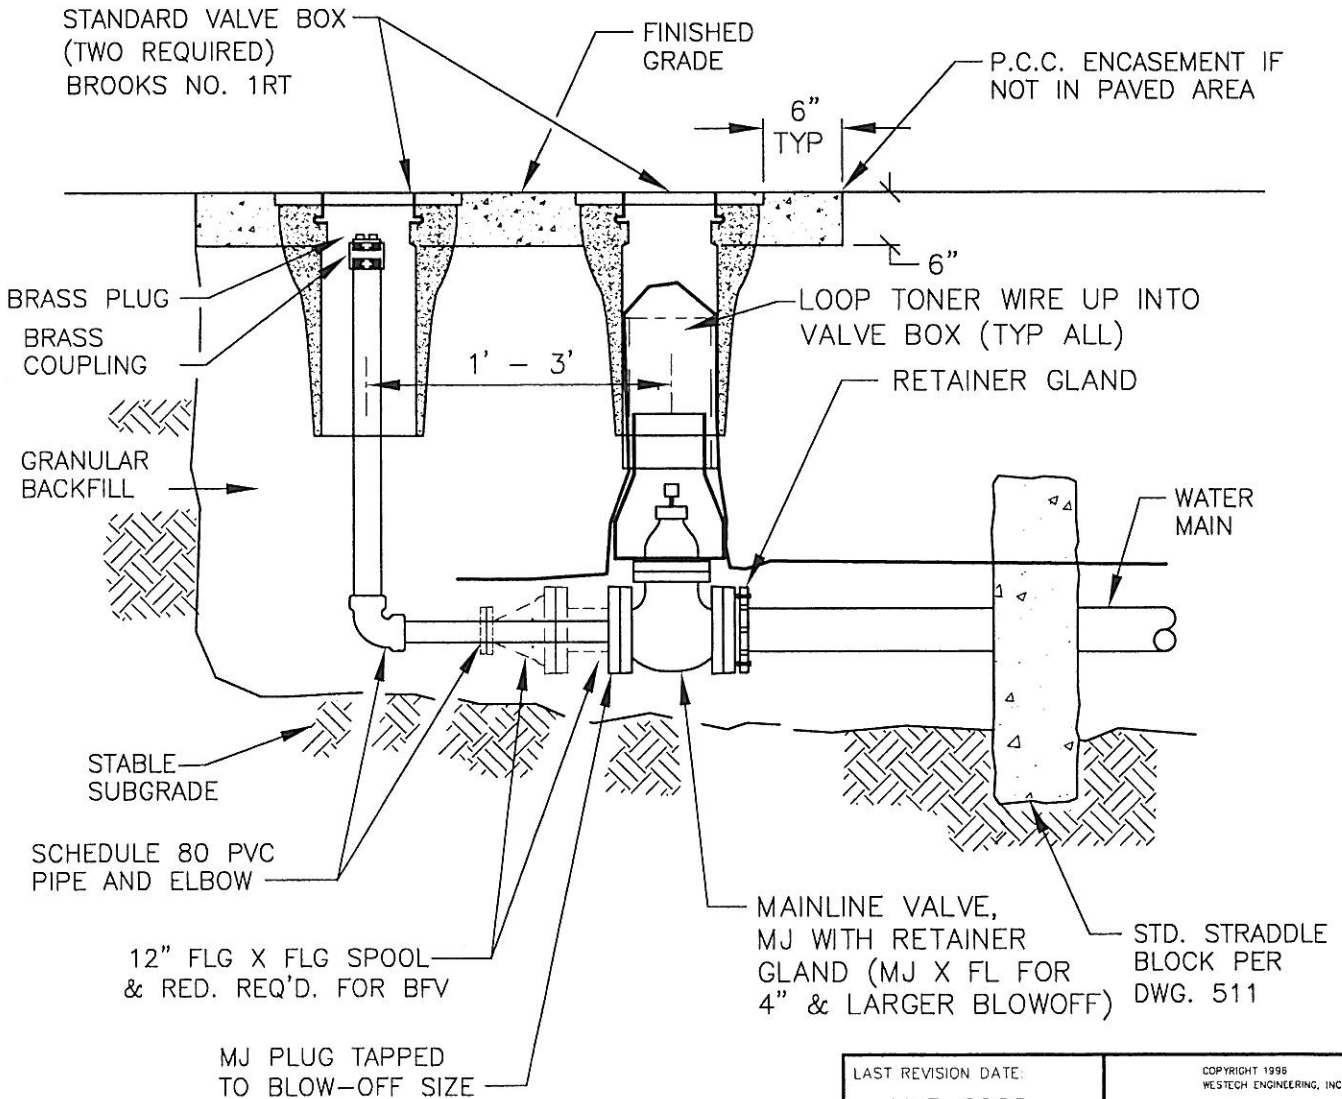

NOTE: PER ORS 92.044(7), VALVE BOXES MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

LAST REVISION DATE:
MAR 2008

COPYRIGHT 1998
WESTECH ENGINEERING, INC

**MAINLINE BLOWOFF
ASSEMBLY**

(NTS)

JUNCTION CITY, OR

DETAIL NO.
506